

2016-07-14

**REQUEST FOR QUOTATION
REMOVAL OF EXISTING UNDERGROUND TANKS AND SUPPLY OF NEW A/G TANK
RFQ #27 (2016-06)
ADDENDUM # 1**

This addendum shall be incorporated into, and form part of RFQ #27 (2016-06) and take precedence over all requirements of the previously issued bid documents including plans. This addendum must be signed by the bidder (signing officer) in the appropriate space and must be attached to the Form for submission by the bidder. This Addendum consists of two (2) pages and the documents listed below.

1. Clarification – Site Preparation

Toronto Zoo staff will remove any temporary/portable obstructions from the area prior commencement of the work.

2. Clarification – Generator

The generator located in the Generator Room (as identified on drawing A-2 Site Plan) supplies emergency power to portions of the Toronto Zoo Operations Complex.

3. Clarification – Fuel Contents (Fuel/Paint/Solvent)

Toronto Zoo will empty tank contents from all tanks prior to commencement of work.

4. Clarification – Concrete Hold Down Pads

Concrete hold down pads are to be removed and disposed of offsite at an appropriate recycling facility.

5. Clarification – Fees & Inspection

Any fees and/or inspections required for this work should be charged directly to the Toronto Zoo and identified with your quotation submission.

6. Clarification – New AST, Piping, Connections, Concrete Pad, etc.

- It is the responsibility of the contractor to provide an engineered design for the above.
- The new AST is to supply the day tank/generator only.

7. Clarification – Decommissioning Report

A decommissioning report will be required as per MOECC B139-06-ON.

8. Clarification – Asphalt Cutting And Patching

The contractor is responsible for cutting and patching of asphalt as required for this project.

9. Clarification – Insurance Requirements

Environmental Impairment Liability with a limit of not less than \$1,000,000 per incident. Coverage shall include third party bodily injury and property damage including on-site and off-site clean-up. If such coverage is written on a claims made basis, the insurance policy shall be maintained for a

REMOVAL OF EXISTING UNDERGROUND TANKS AND SUPPLY OF NEW A/G TANK

period of two years subsequent to conclusion of services provided under the contract or contain a 24 month extended reporting period.

Environmental Insurance is to be included as part of your insurance requirements submission.

10. Clarification – Access to Site & Wildlife Health Centre Construction

The Wildlife Health Centre project will be completed prior to the start of this work and will therefore not affect access to your work site.

11. Clarification – New AST

The new AST is to be connected directly to the existing pump station.

12. Clarification – Warranty

You are to provide a Manufacturer’s Warranty for 10 years and a Contractors Warranty for 1 year.

13. Additional Site Meeting Tuesday, 2016-07-19 at 10:00 a.m.

An additional site meeting has been scheduled if you would like to review the site again.

14. Add Drawings:

- a) S-1 Site Services
- b) A-3 Asphalt Detail

15. Closing Date Extended

The deadline for submissions has been extended to **Thursday, 2016-07-28, 1200 hours (noon, local time).**

Receipt of the Addendum shall be acknowledged as part of your submission.

The Board of Management of the Toronto Zoo reserves the right to reject any or all Quotations or to accept any quotation, should it deem such action to be in its interests.

If you have any queries regarding this matter, please contact Mr. Peter Vasilopoulos, Supervisor, Purchasing & Supply, at 416-392-5916.

Yours truly,

Peter Vasilopoulos
Supervisor, Purchasing & Supply

I/we hereby acknowledge receipt of this addendum and make allowance in my bid.

Signed (Must be Signing Officer of Firm)

Name of Firm


Date:

RFQ 27 (2016-06) – ADDENDUM #1
REMOVAL OF EXISTING UNDERGROUND TANKS AND SUPPLY OF NEW A/G TANK

4.2 UNIT RATES - REVISED

DESCRIPTION	Price complete excluding HST
Environmental sampling per location	\$ /each
Machine excavation, load, transport and off-site disposal of contaminated soil as per TSSA (Technical Standards and Safety Authority) regulations.	\$ /m ³
Hand excavation, load, transport and off-site disposal of contaminated soil as per TSSA (Technical Standards and Safety Authority) regulations.	\$ /m ³
Hydro-vac excavation and off-site disposal of contaminated soil as per TSSA (Technical Standards and Safety Authority) regulations.	\$ /m ³
Supply of backfill, placing and compaction of Granular A	\$ /m ³
Supply of backfill, placing and compaction of Granular B	\$ /m ³

	COMMUNICATION
	IRRIGATION
	HIGH VOLTAGE
	HYDRO
	WATER
	GAS
	STORM
	SANITARY
	FIBRE OPTICS
	DUCT BANK ROUTING
	ROAD CROSSING/ CONCRETE ENCASED DUCTS
	DIRECTIONAL BORING
	POWER MANHOLE
	COMMUNICATIONS MANHOLE

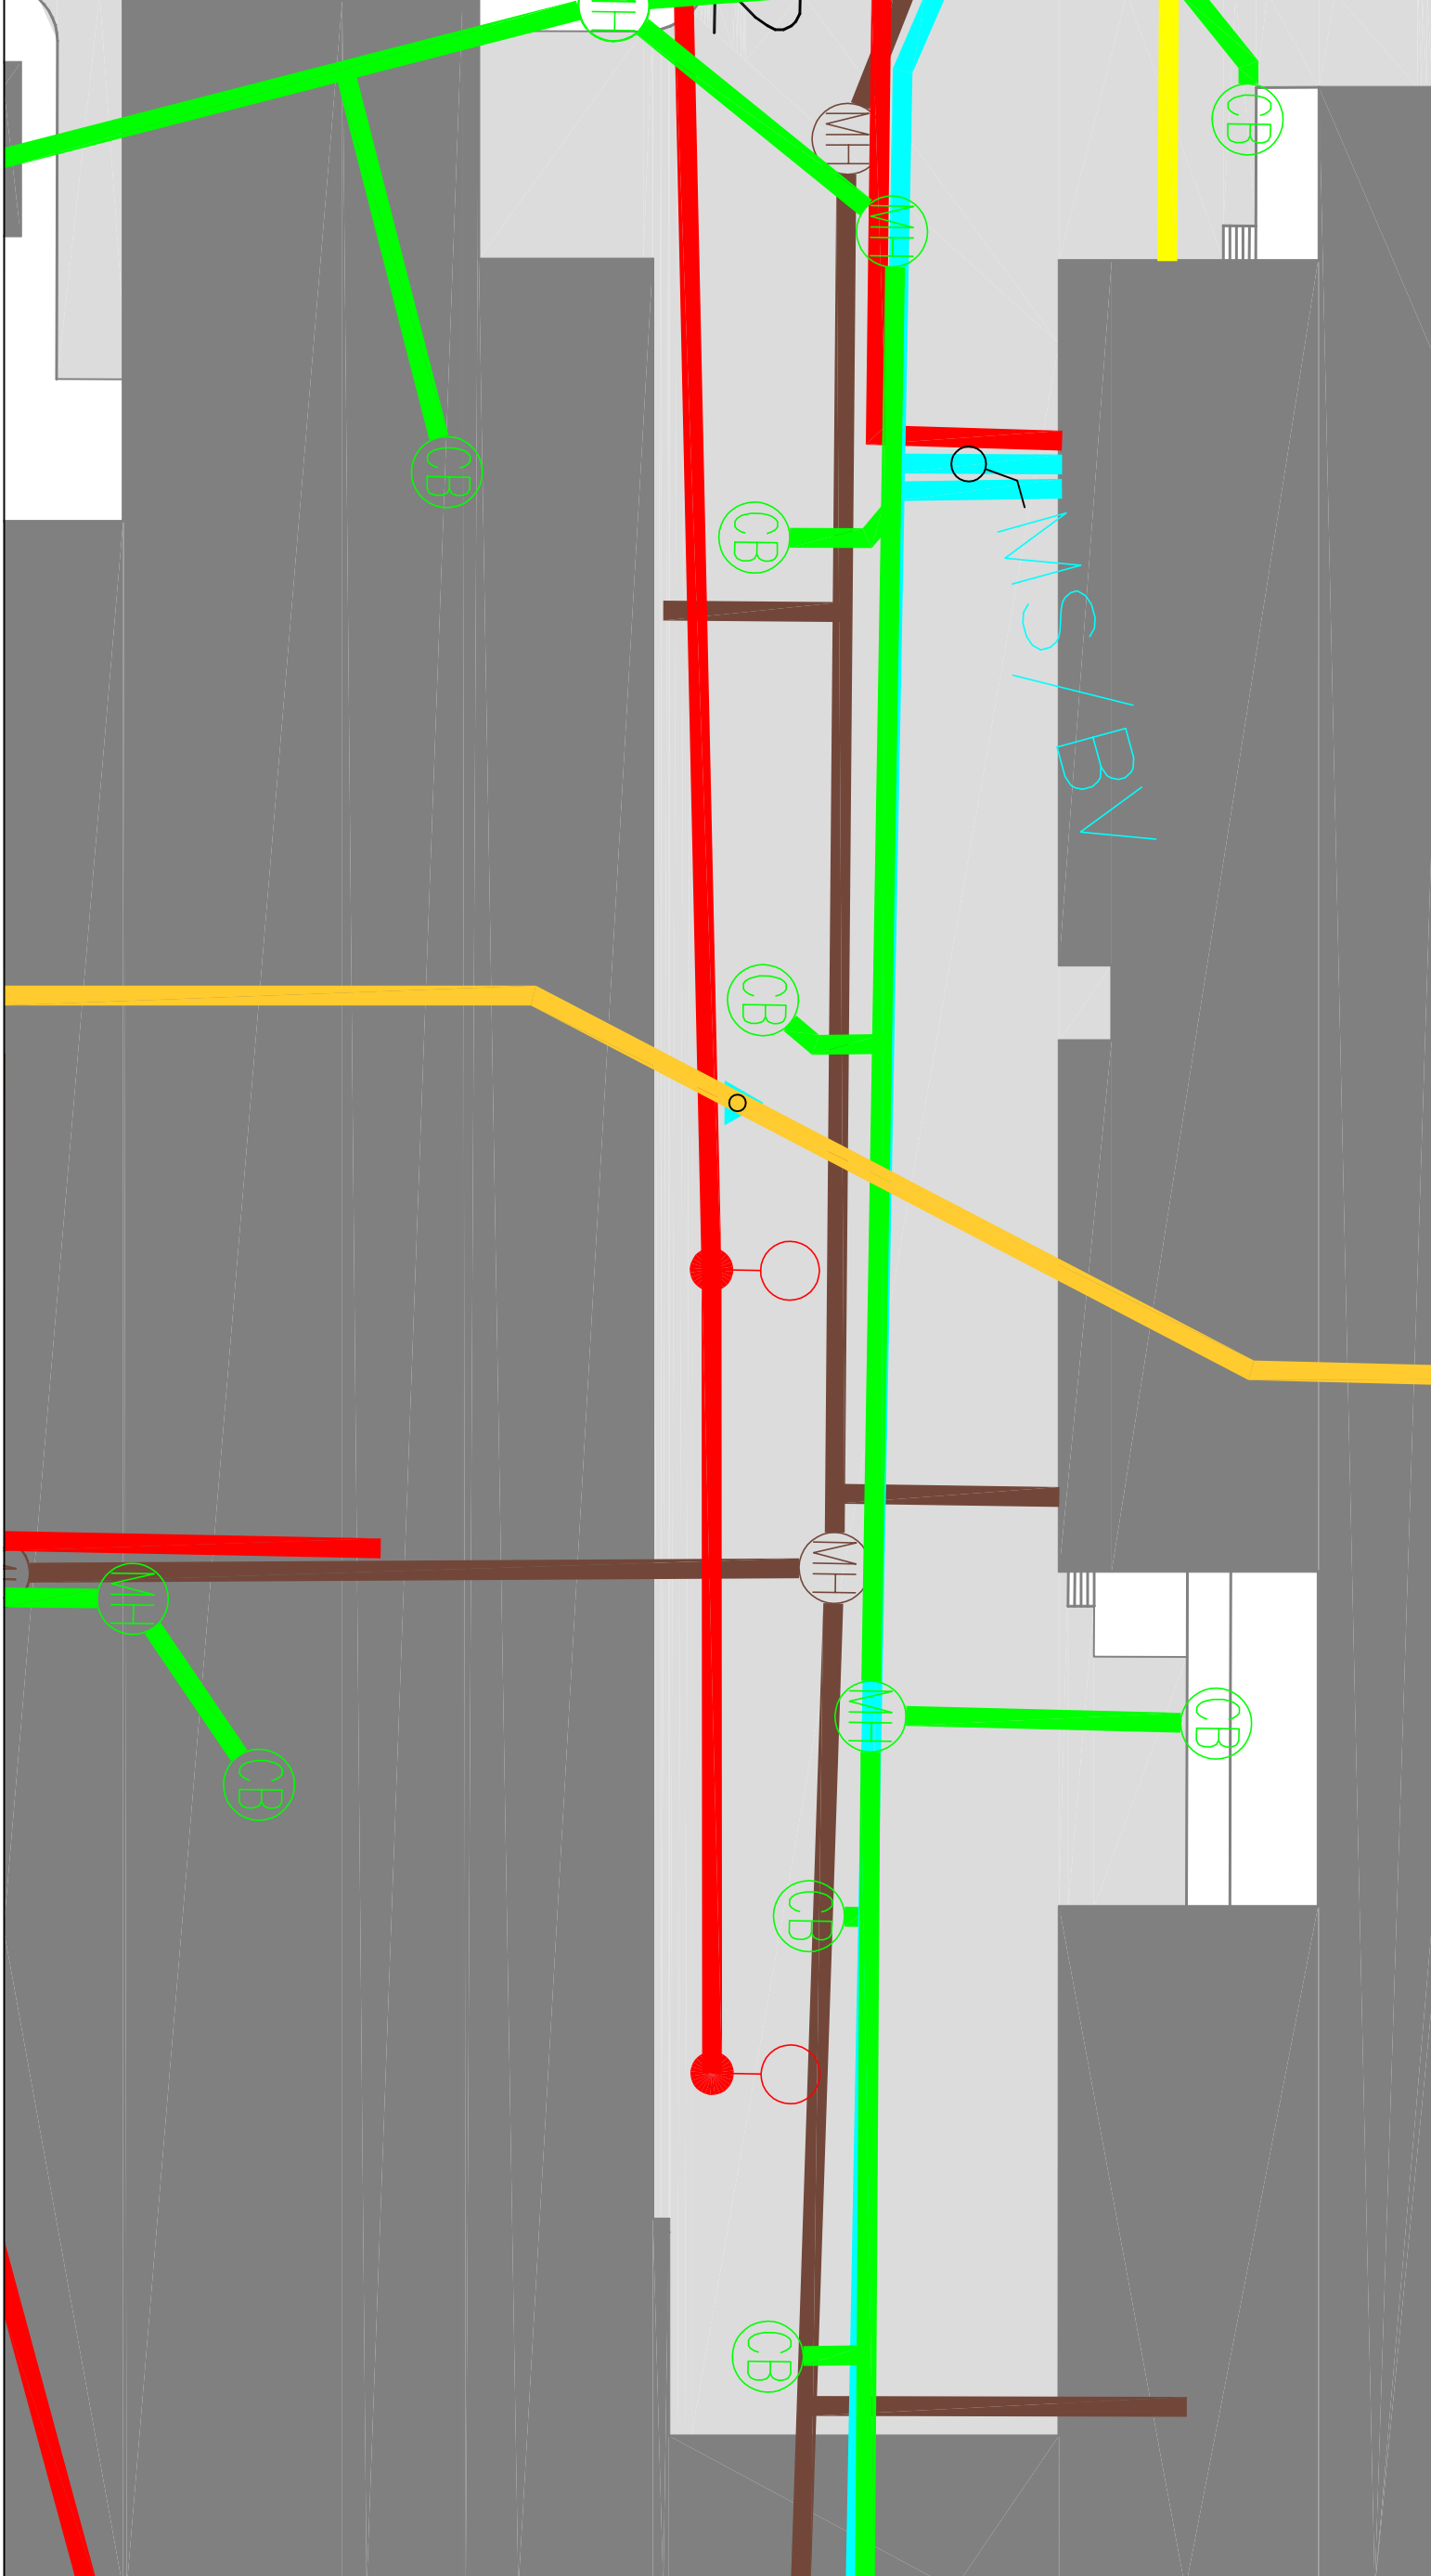


NORTH SERVICE BUILDING -
FACILITIES & MAINTENANCE CENTRE



361A OLD FINCH AVE.
TORONTO, ON
M1B 5K7

NO.	DESCRIPTION	DATE
2	FOR ADDENDUM 1	2016.07.11

NO.	REVISIONS	DATE



REMOVAL &
RELOCATION OF
UNDERGROUND
FUEL TANKS

APPROVED BY
NAME:

DATE:

SITE SERVICES

PROJECT #: 16OP10
 DRAWN BY: D.G.
 CHECKED BY: LEONA MITCHELL
 DATE: 2016-07-11
 SCALE: 3/64" = 1'-0"
 DRAWING #: S-1

NO.	DESCRIPTION	DATE
2	FOR ADDENDUM 1	2016.07.14

NO.	REVISIONS	DATE

**REMOVAL &
RELOCATION OF
UNDERGROUND
FUEL TANKS**


REVIEWED BY
MANAGER:
DATE:
CURATOR:
DATE:
APPROVED BY
COO:
DATE:

ASPHALT DETAIL

PROJECT #: 160P10
DRAWN BY: D.G.
CHECKED BY: LEONA MITCHELL
DATE: 2016-07-14
SCALE: 1" = 1'-0"

DRAWING #:

A-3

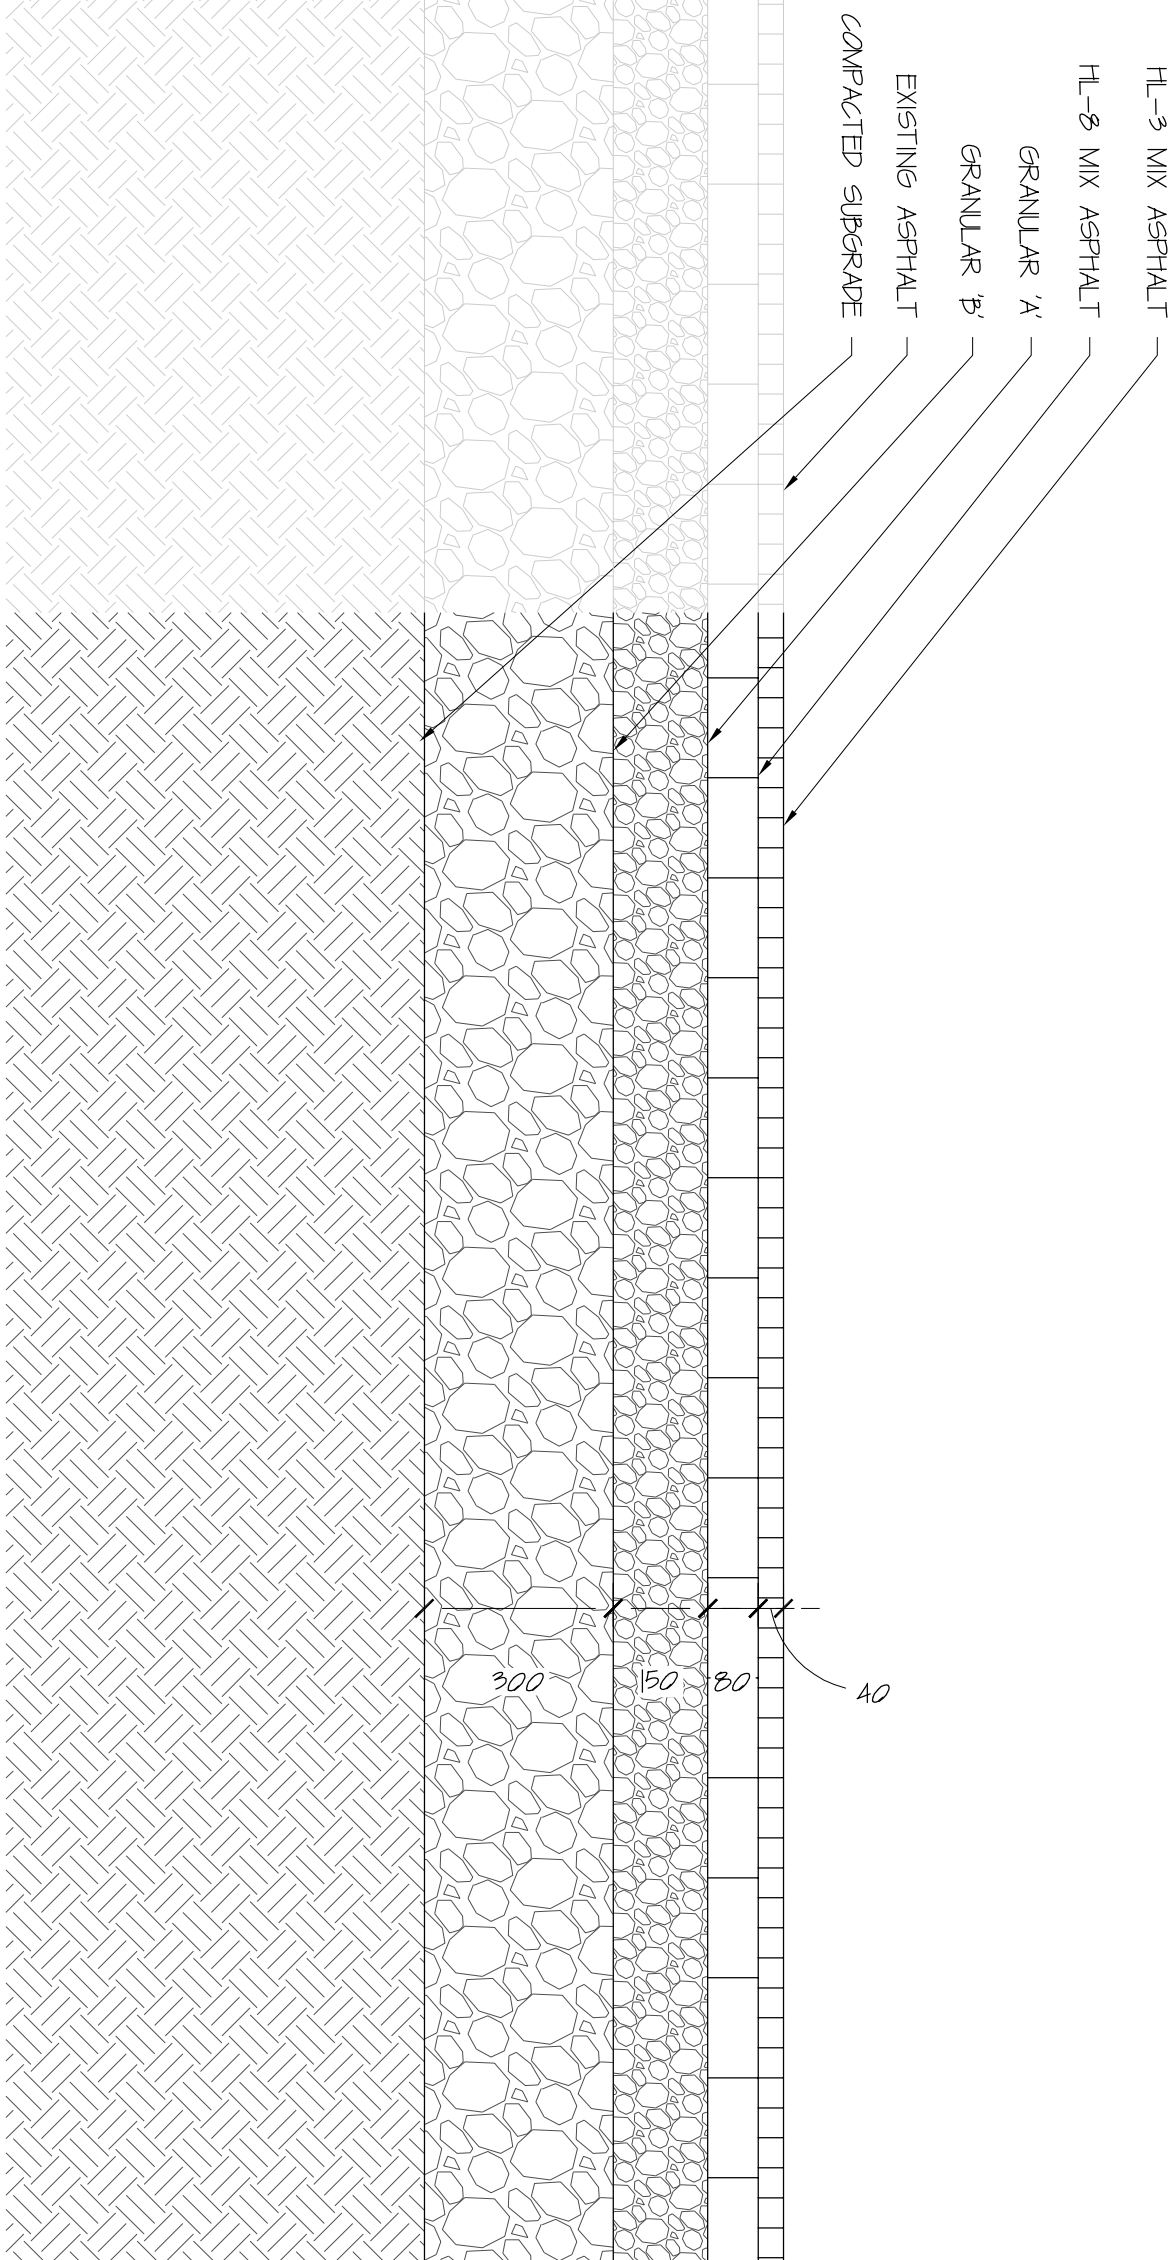

1

SECTION

SCALE: 1" = 1'-0"