

2022-08-26

**REQUEST FOR TENDERS
AUSTRALASIA OUTDOOR AVIARY
TZC T 41 (2022-08)
ADDENDUM #1**

This addendum shall be incorporated into, and form part of TZC T 41 (2022-08) and take precedence over all requirements of the previously issued bid documents including plans. This addendum must be signed by the bidder (signing officer) in the appropriate space and must be attached to the Form for submission by the bidder. This Addendum consists of two (2) pages and the attached documents.

1. Part 3 – Scope

1.0 SCOPE OF WORK – Additional Requirements

Contractor to run electrical servicing through conduit along the outside perimeter of the aviary to the heated shed. See drawing A3.01 and A3.06.

2. DRAWING A3.01 – Change in Scope

Original – HEATED WATER BOWL, TZ TO SUPPLY, CONTRACTOR TO INSTALL.

Change – HEATED WATER BOWL, CONTRACTOR TO SUPPLY INSTALL NELSON FREE STANDING 700 SERIES (MODEL 730-10) WATERER.

- 3. Question:** Can you please supply an elevation for the two new aluminum doors? There are width shows on the drawings, but no heights.

Answer: The height of the doors is 95". It is the responsibility of the contractor to verify all dimensions on site.

- 4. Question:** I see in the scope of work a height of 7'. Is the assumption that the 7' plus the top header of the frame will fill this space fully, and no top panel will be necessary? Scope of work notes that glass transom is necessary for openings larger than 7'.

Answer: No top panel or transom required. The Zoo would like full 95" doors.

- 5. Question:** Also, is Alumaticore the only accepted aluminum door material?

Answer: The Zoo is asking for 400 series of Alumaticore doors.

- 6. Question:** Can you please confirm which BEA switches they would like as per the door specification.

Answer: Please use model MS21 "SHORT-RANGE TOUCHLESS ACTUATOR".

- 7. Question:** Can you please illustrate on the drawings the routing of the electrical connections for all the new elements (automatic door closers, shed heaters, etc.)

Answer: Please see attached – DRAWINGS – AUSTRALASIA OUTDOOR AVIARY (2022-08-24) ADDENDUM 1.

8. Question: Please confirm the new glass door sizes

Answer: Please refer to questions 3 and 4.

Receipt of the Addendum shall be acknowledged as part of your submission.

The Board of Management of the Toronto Zoo reserves the right to reject any or all Tenders or to accept any quotation, should it deem such action to be in its interests.

If you have any queries regarding this matter, please contact Mr. Peter Vasilopoulos, Supervisor, Purchasing & Supply, at 416-392-5916 or by email pvasilopoulos@torontozoo.ca.

Yours truly,

Peter Vasilopoulos
Supervisor, Purchasing & Supply

I/we hereby acknowledge receipt of this addendum and make allowance in my bid.

Signed (Must be Signing Officer of Firm)

Name of Firm

Date:

END OF ADDENDUM 1

NO.	DESCRIPTION	DATE
0	ADDENDUM 1	2022-08-24

NO.	REVISIONS	DATE
-----	-----------	------



**RESTORATION OF
AUSTRALASIA OUTDOOR
AVIARY PROJECT**


REVIEWED BY
MANAGER: AMBER DIGNARD
DATE:
CURATOR:
DATE:
APPROVED BY
COO:
DATE:

**PROPOSED ELECTRICAL
FEED LINE**

PROJECT #:
DRAWN BY: M.R.
CHECKED BY:
DATE: 2022-08-04
SCALE: 1/8" = 1'-0"

DRAWING #:

A3.07

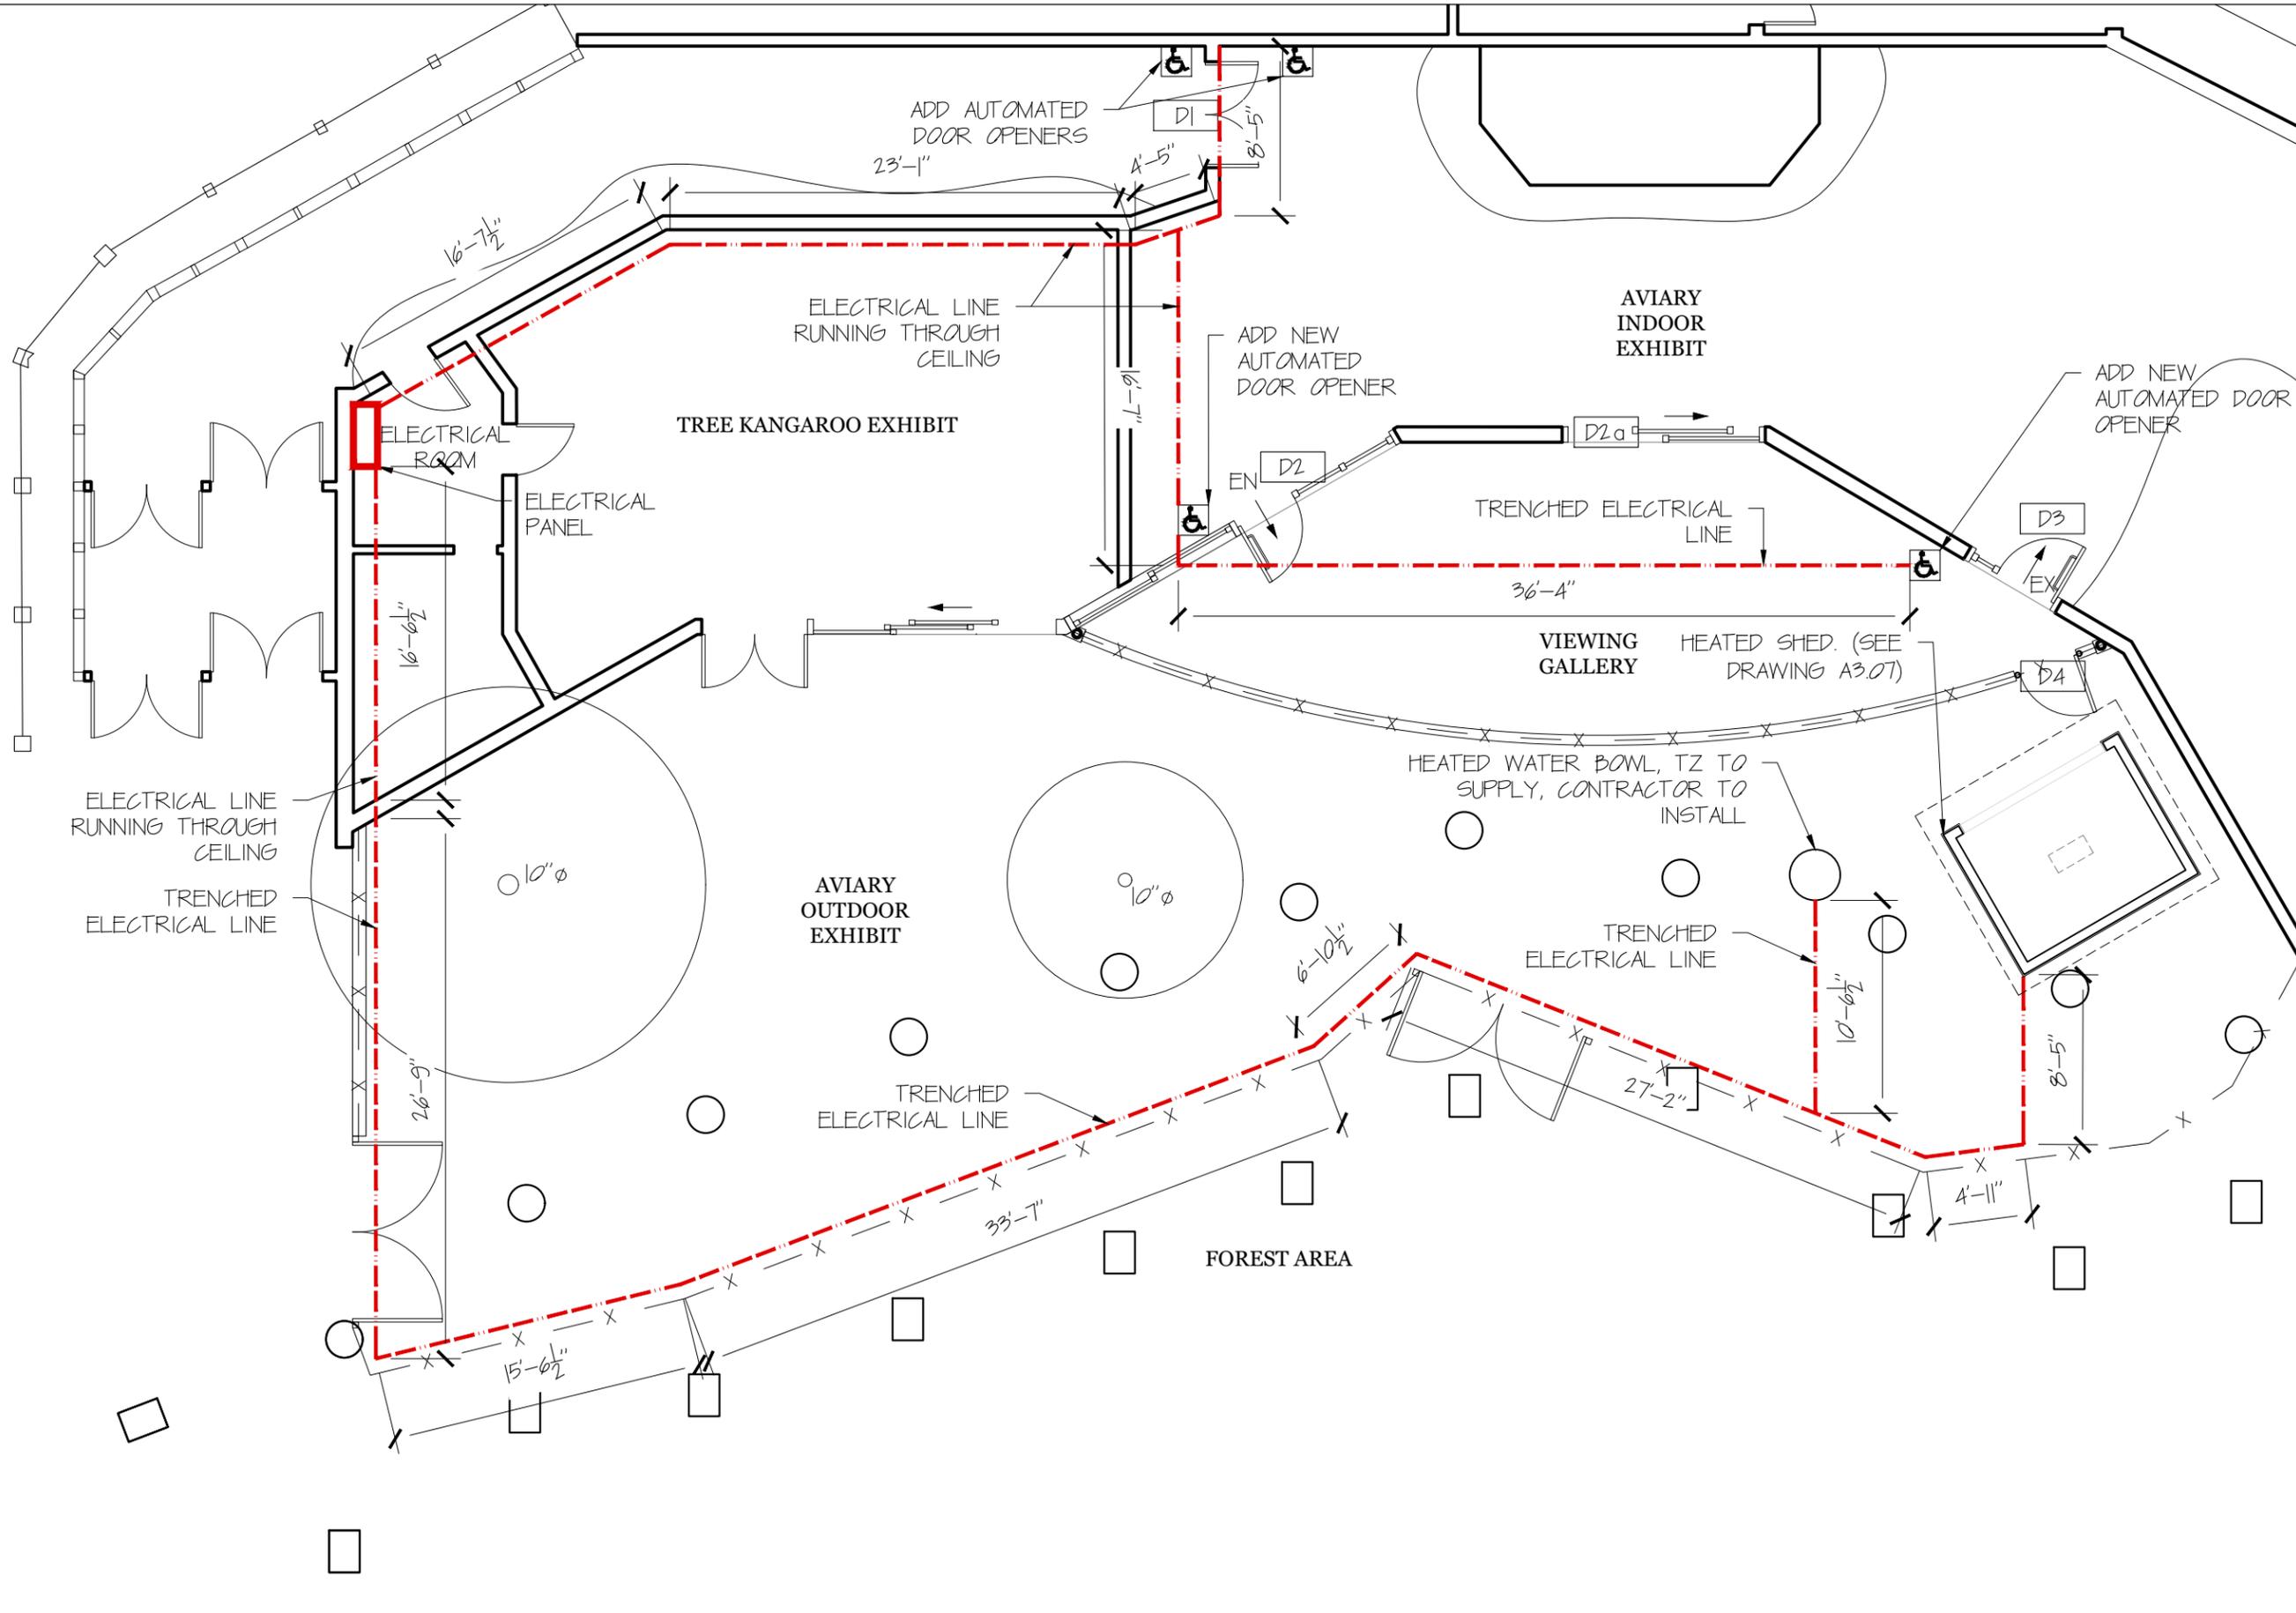

1 PROPOSED ELECTRICAL FEED LINE
SCALE: 1/8" = 1'-0"